
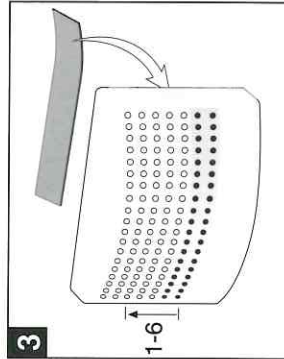
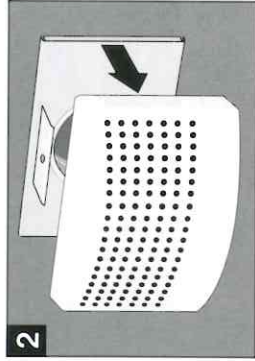


$$q_v = k \times \sqrt{\Delta p_m}$$

	k		
	Tuloilma Tilluft Supply air	125	Poistoilma Frånluft Exhaust air
OKI	100	100 ja 125	
A	3,5	3,5	3,8
	1	3,1	3,3
	2	2,6	2,8
	3	2,2	2,4
	4	1,7	1,9
	5	1,3	1,5
	6	0,9	1,1
Suljettu			
Stängda			
Closed			

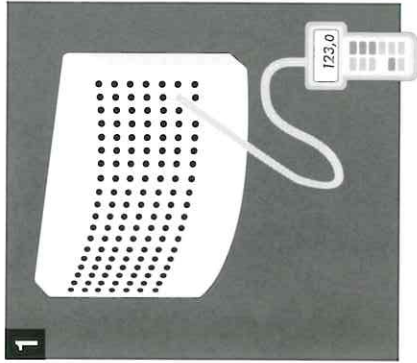

$$q_v = k \times \sqrt{\Delta p_m}$$

	k	
	Tuloilma Tilluft Supply air	125
OKI-P	100	125
A	3,5	3,5
	1	3,1
	2	2,6
	3	2,2
	4	1,7
	5	1,3
	6	0,9
Suljettu		
Stängda		
Closed		

